


1. FOR LEGEND SEE DWG. #E-1 AND LIGHTING FIXTURE SCHEDULE
2. FOR TYPICAL SUBSTATION STATION
3. REMOVE ABANDONED FIRE ALARM SYSTEM 3 SEE NOTE #3
4. INTERCEPT AND REROUTE EXISTING WIRE IN REROUTED CONDUIT IN JUNCTION BOXES.

PLAN-76th FL.-SS-75E

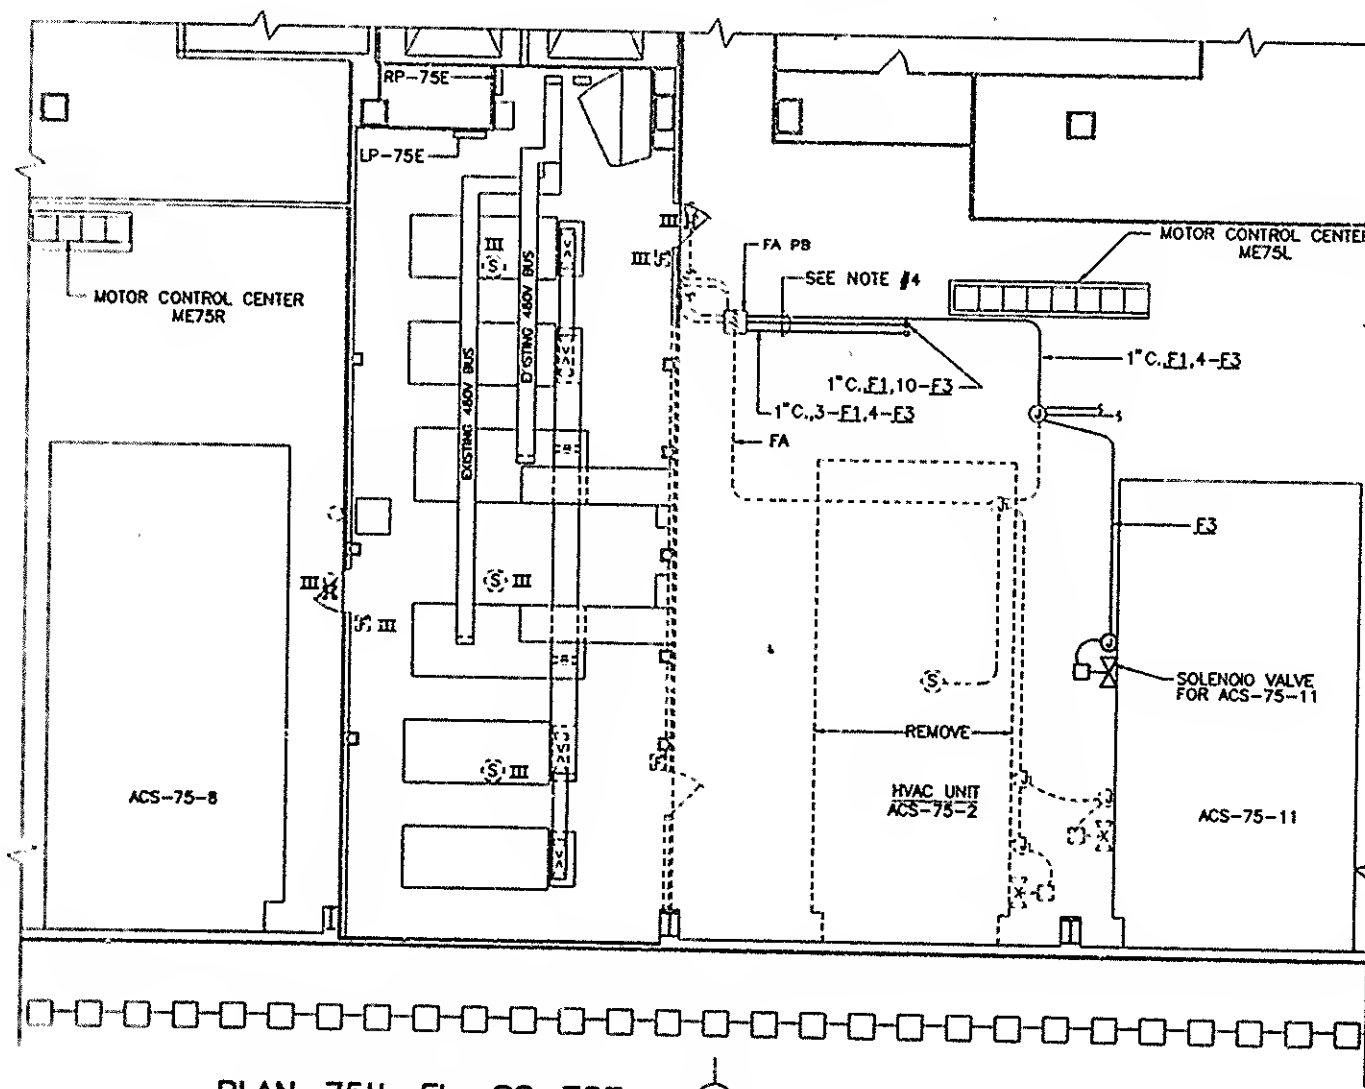

PLAN-75th FL.-SS-75E